





Fox products utilized to seal water leaks in electrical conduits Public Service Electric & Gas Co.



Overall view of vault containing open electrical ducts.

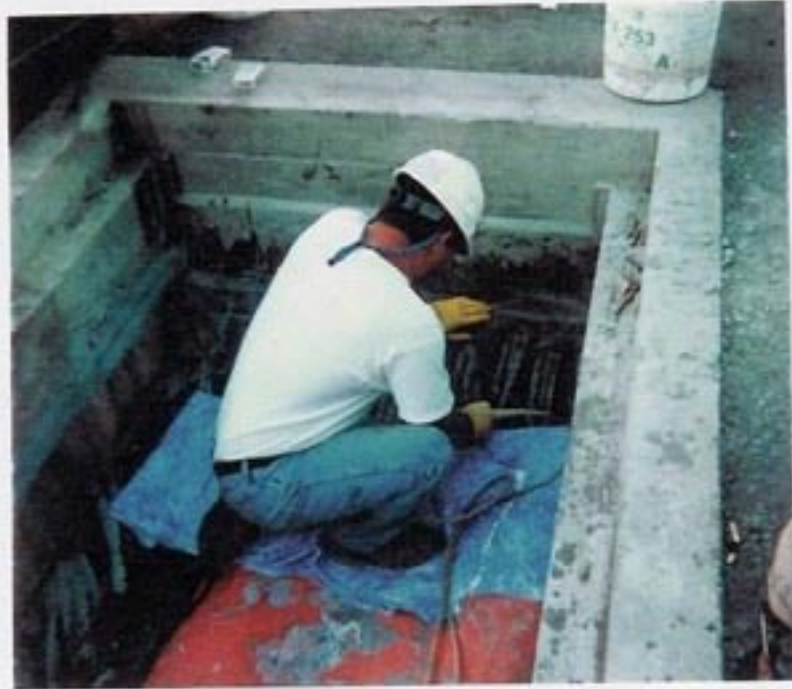

The ducts are sealed using FX-III Jet Set and plain jute rope.

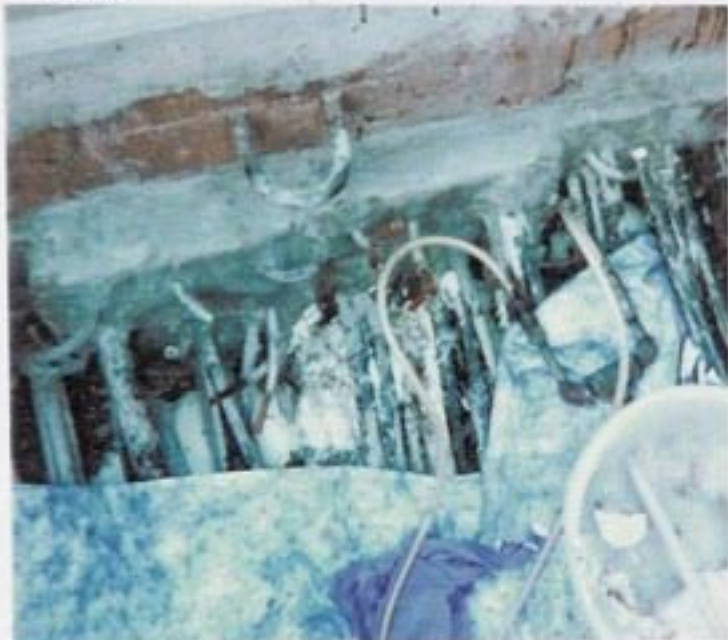

Close up view showing FX-III Jet Set pumped into conduits packed with jute rope.



Overall view of completed job. The FX-III Jet Set remains flexible and will provide a watertight seal.